

SAND MOUNTAIN ELECTRIC COOPERATIVE MOBILE HOME INSTALLATION GUIDELINES

SERVICE REQUIREMENTS

Must complete application

Must pay construction cost and deposit

Must obtain building or parking permit

(Rainsville, Hammondville & Collinsville must obtain from the City Hall)

Must obtain easements for right of way

Must obtain meterbase from SMEC

Must obtain pole and guy location – required after mobile home is located on property.

POLE REQUIREMENTS

Must be factory treated for earth contact to prevent decay

Must be at least 4' in the ground and guyed (if required)

Must be provided and installed by customer

Must be at least 20' long. Must be six (6) inches in diameter at top of pole.

Must be installed a maximum of 30' from the structure being serviced.

CONDUIT OR SERVICE ENTRANCE CABLE TYPE:

Weatherhead to outside disconnect:

Rigid or EMT with rain tight fittings.

Outside disconnect to inside panel:

Rigid, metallic and non-metallic or EMT

Pole 2' or less from mobile home

Conduit may be buried or above ground

Pole over 2' from mobile home

Conduit must be buried


**NOTE: EMT CONDUIT IS NOT APPROVED FOR BURIAL
USE SCHEDULE 40 OR SCHEDULE 80 PVC, OR RIGID METAL.**

**NOTE: DO NOT USE SERVICE ENTRANCE CABLE FROM
DISCONNECT INTO INSIDE PANEL OF HOME**

**NEC REQUIRES CUSTOMER OWNED POLE TO BE WITHIN 30' OF MOBILE HOME. IF FURTHER
IN DISTANCE A SECOND DISCONNECT WILL BE REQUIRED.**

WIRING DIAGRAM

DO NOT CUT # 4 BARE COPPER GROUND.
IT MUST BE A CONTINUOUS PIECE FROM
GROUND ROD TO METERBASE

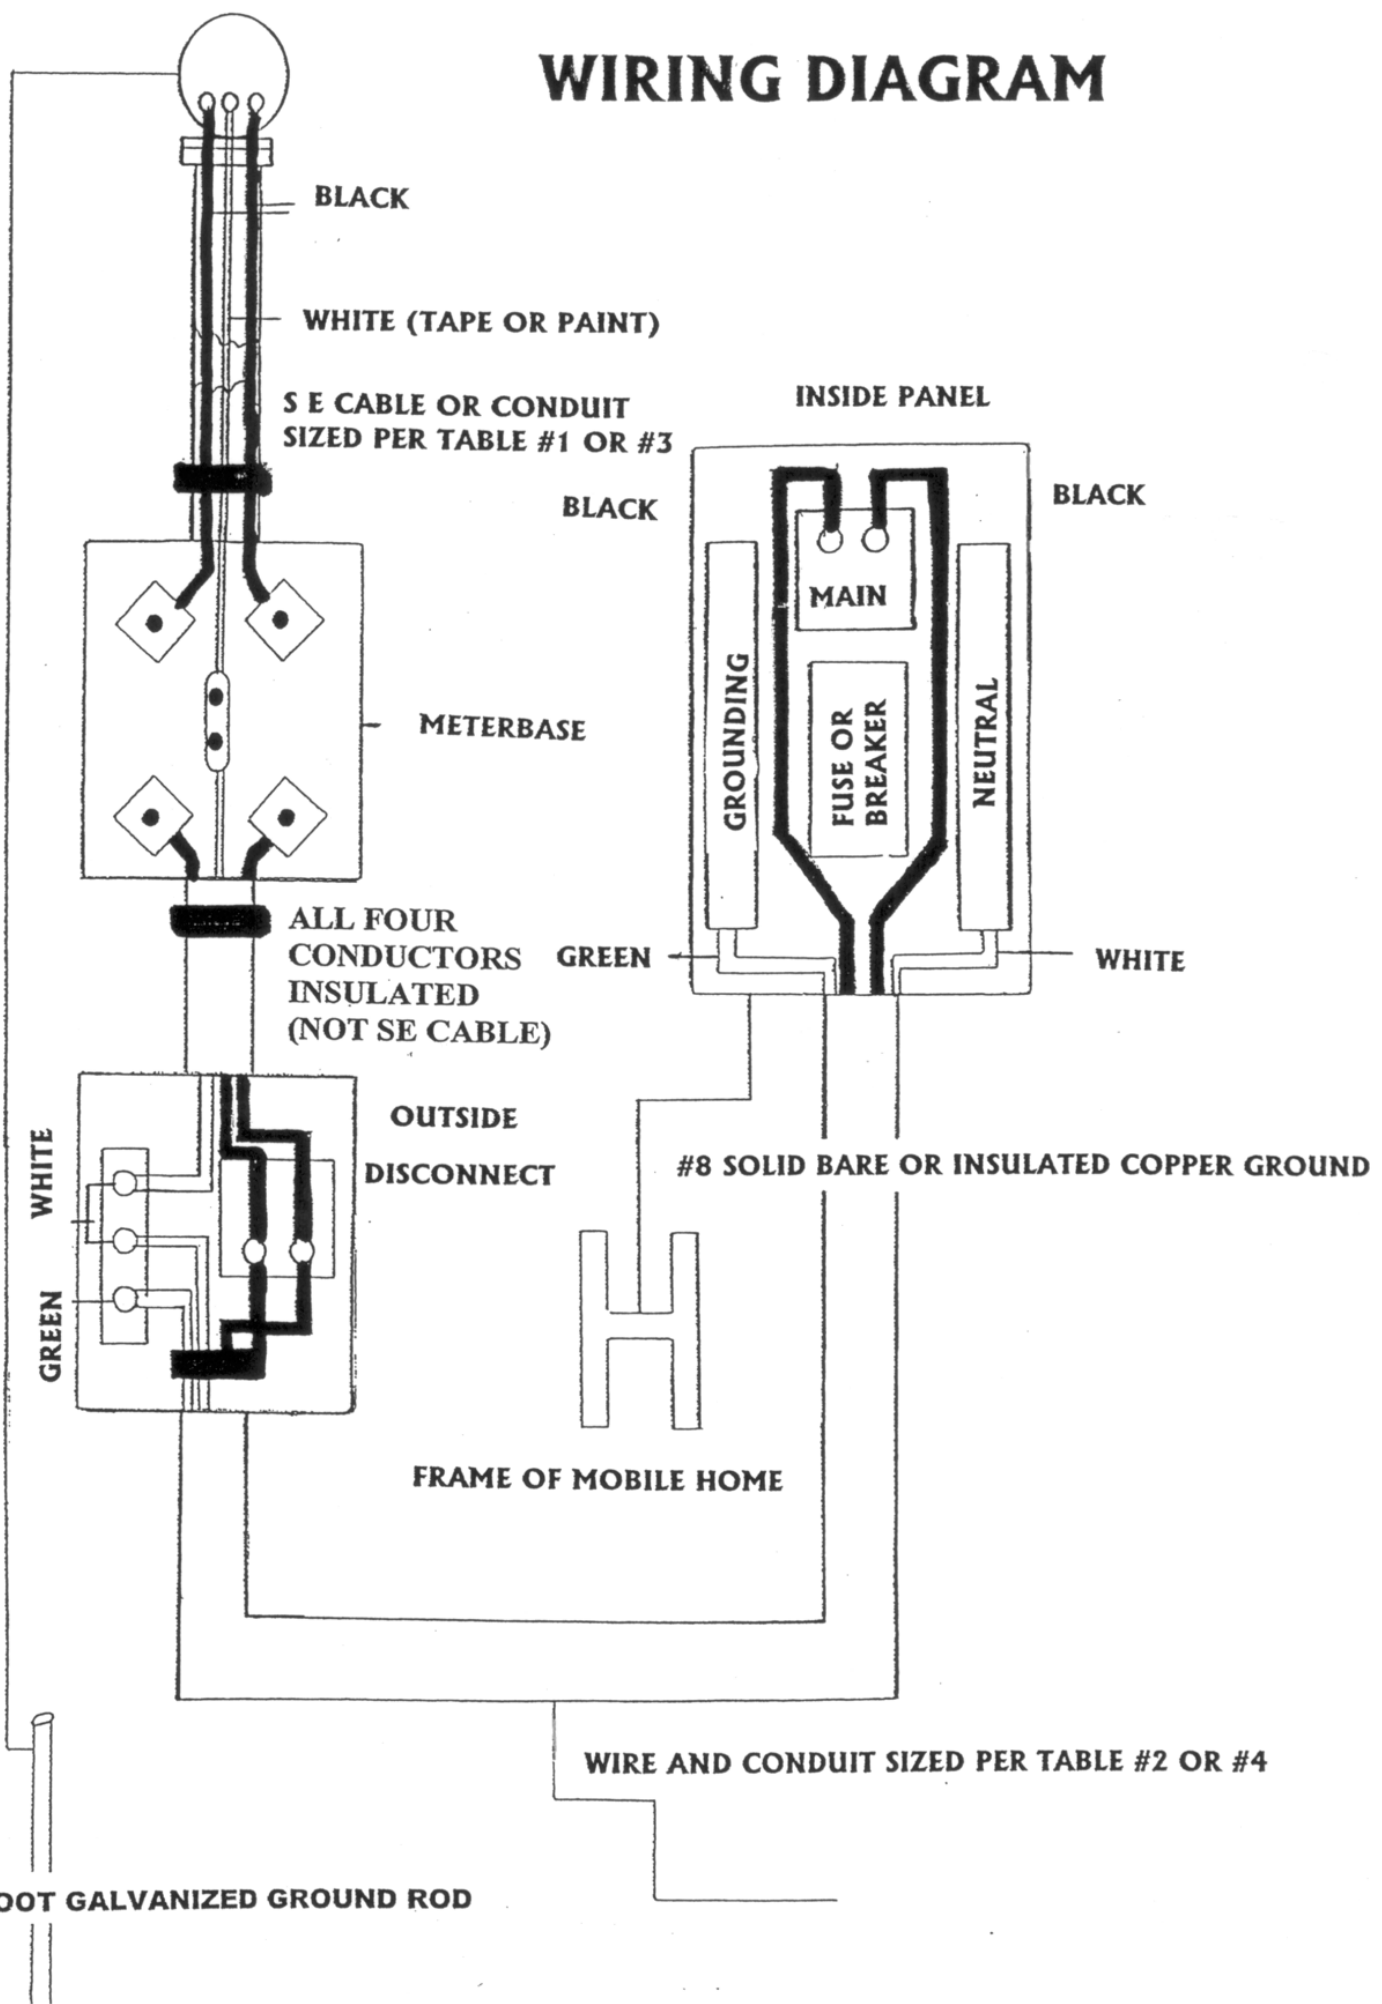

4 SOLID BARE COPPER

5 E CABLE OR CONDUIT
SIZED PER TABLE #1 OR #3

ALL FOUR
CONDUCTORS
INSULATED
(NOT SE CABLE)

#8 SOLID BARE OR INSULATED COPPER GROUND

WIRE AND CONDUIT SIZED PER TABLE #2 OR #4

5/8" X 8 FOOT GALVANIZED GROUND ROD

**MOBILE HOME MUST BE IN PLACE
AT TIME OF INSPECTION!**

POLE DIAGRAM

WITH IN 2' OF THE TOP OF POLE

EXTEND CONDUCTORS 2' BEYOND WEATHERHEAD

CONDUIT OR S E CABLE

CONDUIT STRAP OR S E CABLE CLAMP

METERBASE

METERBASE AND DISCONNECT MUST BE
SECURELY FASTENED TO POLE

WEATHERPROOF UL APPROVED MAIN
DISCONNECT, SIZE ACCORDING TO INSIDE PANEL

LOCKNUT AND BUSHINGS

4 FEET TO 6 FEET

OVERALL LENGTH OF 20 FOOT POLE / WITH 4 FEET IN GROUND /
LEAVING A 16-FOOT CLEARANCE.


MOBILE HOME

INSIDE
PANEL

8 SOLID BARE COPPER
OR INSULATED.

MUST HAVE ALL 4 INSULATED CONDUCTORS IN CONDUIT
SCHEDULE 40 PVC.
RECOMMENDED BURIAL DEPTH OF 24" IF POLE IS MORE
THAN 2 FEET FROM MOBILE HOME.

5/8 " X 8 FOOT GROUND ROD
BARE # 4 SOLID COPPER WIRE CONNECTED
TO GROUND ROD WITH (1) PIECE OVAL
BRASS CLAMP.

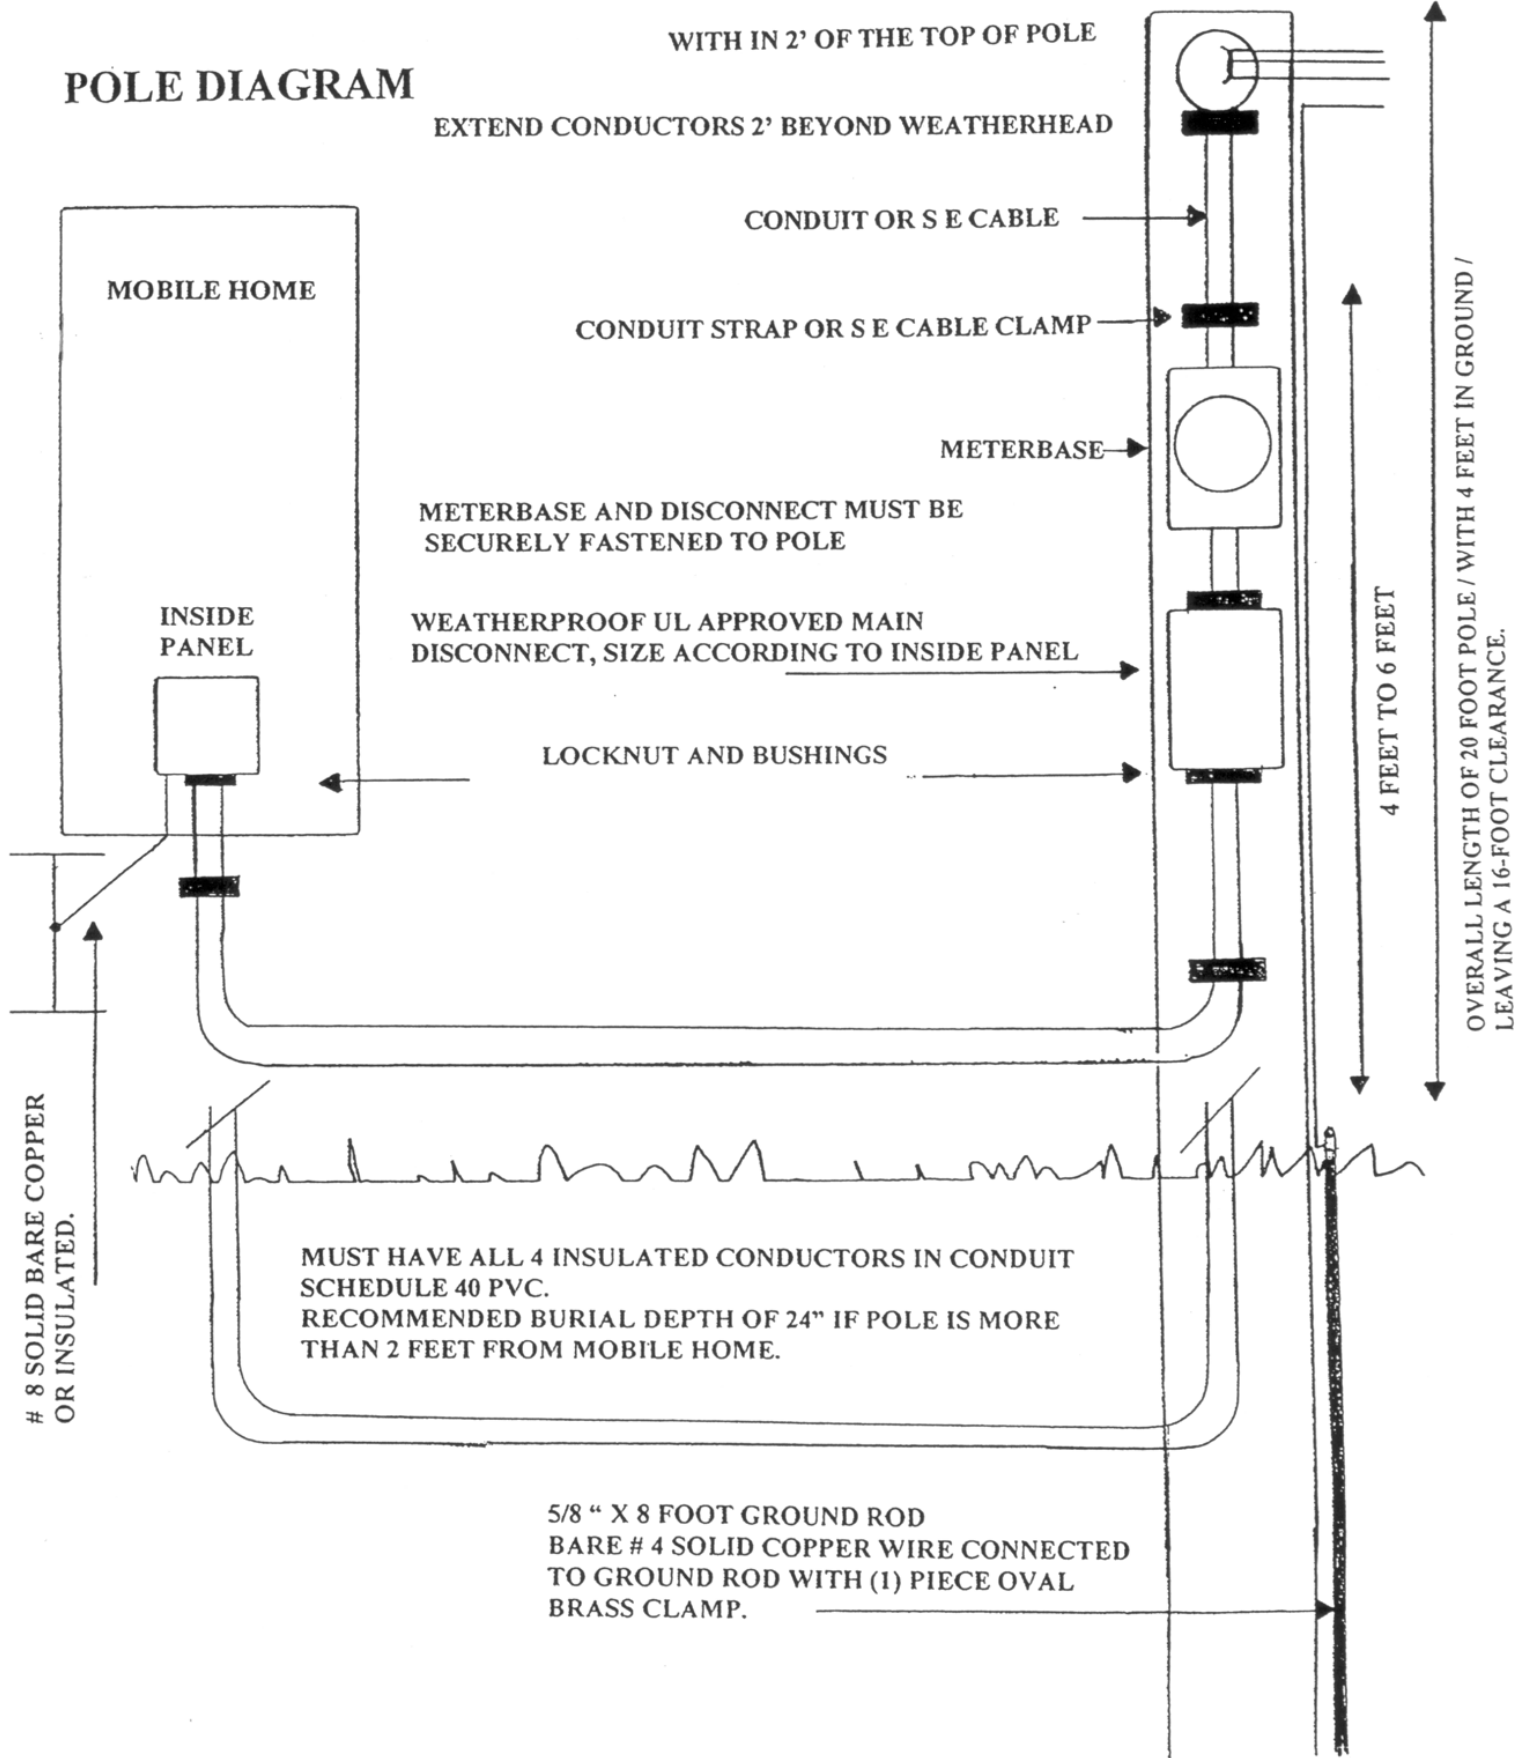

MINIMUM CONDUIT AND WIRE SIZE

TABLE 1. Wire Size from Weatherhead to:
OUTSIDE DISCONNECT

COPPER	60A	100A	125A	150A	200A
2-Black	6	4	2	1	2/0
1-White	8	8	8	6	4
Conduit Size	1"	1 ¼"	1 ¼"	2"	2"

TABLE 3.

ALUMINUM					
2-Black	4	2	1/0	2/0	4/0
1-White	6	6	6	4	2
Conduit Size	1 ¼"	1 ½"	2"	2"	2"

TABLE 2. Wire Size from Outside Disconnect to:

INSIDE PANEL

COPPER	60A	100A	125A	150A	200A
2-Black	6	4	2	1	2/0
1-White	8	8	8	6	4
1-Green	10	10	8	6	6
Conduit Size	1 ¼"	1 ¼"	1 ¼"	2"	2"

TABLE 4.

ALUMINUM					
2-Black	4	2	1/0	2/0	4/0
1-White	6	6	6	4	2
1-Green	8	6	6	4	4
Conduit Size	1 ¼"	1 ½"	2"	2"	2"

All wire must be temperature rated for 75 degree C (Distributor Requirement)

